


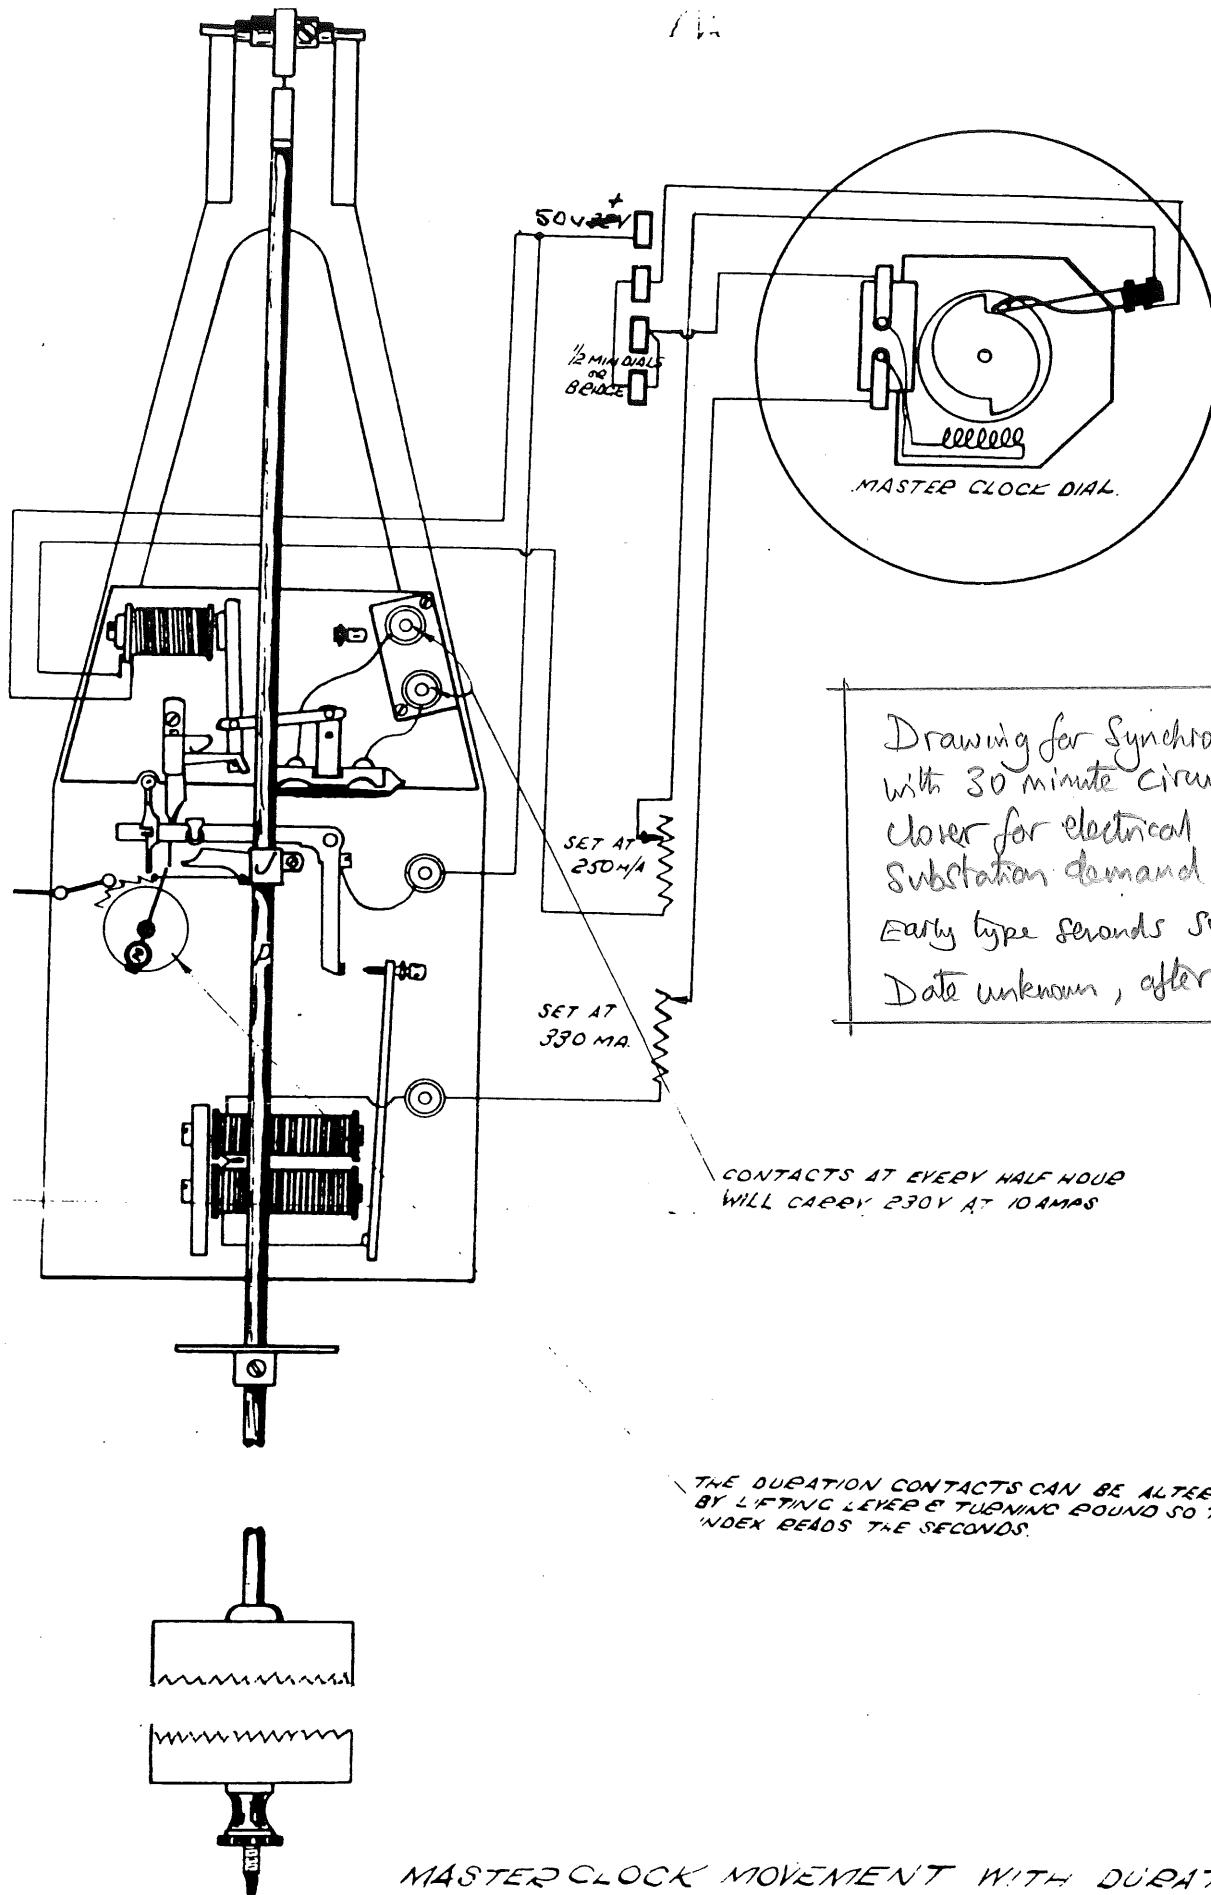

Drawing for Synchronome
with 30 minute circuit
closer for electrical
substation demand meter
Early type seconds switch
Date unknown, after 1938

CONTACTS AT EVERY HALF HOUR
WILL CARRY 230V AT 10 AMPS

THE DURATION CONTACTS CAN BE ALTERED
BY LIFTING LEVER & TURNING ROUND SO THAT
INDEX READS THE SECONDS.

MASTER CLOCK MOVEMENT WITH DURATION
REDUCER ADJUSTABLE FOR CLOSING CIRCUIT FROM
2 TO 28 SECONDS, OPERATED EVERY HALF HOUR FROM
MASTER CLOCK DIAL

DWG N°19443

THE SYNCHRONOME CO LTD — ALPERTON — MIDDLESEX